



## Energy Audit Report for St Luke's Church



Site Address	St Luke's Church, Wythenshawe, M22 4PT
Church Code	624167
Author	Ros Harwood, Graduate Consultant
Date	21 <sup>st</sup> February 2020
Version	1.0

# 1 Executive Summary

An energy survey of St Luke's Church, Brownley Street, Wythenshawe, M22 4PT was undertaken by ESOS Energy Ltd to provide advice to the Church on how it can be more energy efficient and provide a sustainable and comfortable environment to support its continued use. This audit has been provided in conjunction with 2buy2, the Church of England's Parish Buying scheme provider.

This energy audit has been undertaken by a suitably qualified and experienced energy auditor. Benefits of implementing the opportunities identified in this Report include a reduction in energy costs in the first instance, but could also reduce other costs, increase staff awareness and engagement, and improve comfort and staff satisfaction in the workplace.

The Church has a number of ways in which it can be more energy efficient. Our key recommendations have been summarised in the table below and are described in more detail later in this report. It is recommended that this table is used as the action plan for the church in implementing these recommendations over the coming years.

Energy Saving Measure	Annual Energy Savings (kWh)	Annual Cost Savings (£)	Estimated Capital Cost	Payback Period (Years)	Annual Carbon Savings (Tonnes CO <sub>2e</sub> )
Install insulating lagging on boiler pipework (estimated 3% saving)	2,910	£146	£200	1.5	0.6
Main Church – replace 28W uplights with 7.5W LED alternatives.	149	£26	£140	5.5	<0.1
Main Church – replace 100W halogen spotlights with 12.5W LED alternatives.	728	£127	£80	6.5	0.2
Main Church – replace 100W halogen floodlights with 60W LED alternatives.	125	£22	£150	7.0	<0.1
Main Church – replace 28W CFLs with 7.5W LED alternatives.	96	£17	£90	5.5	<0.1
Chapel – replace 28W CFLs with 7.5W LED alternatives.	53	£9	£50	5.5	<0.1
Kitchens - replace 65W T8 fluorescent tubes with 22W LED alternatives.	45	£8	£20	2.5	<0.1
Kitchens - replace 28W CFLs with 7.5W LED alternatives.	21	£4	£20	5.0	<0.1
Community Rooms – replace 28W CFLs with 7.5W LED alternatives.	53	£9	£50	5.0	<0.1
Community Rooms – replace 65W T8 fluorescent tubes with 22W LED alternatives.	134	£23	£60	2.5	<0.1
Community Rooms - replace 65W twin T8 fluorescent tubes with 22W LED alternatives.	537	£94	£240	2.5	0.2
Corridors – replace 28W CFLs with 7.5W LED alternatives.	53	£7	£50	5.5	<0.1

Toilets – replace 65W T8 fluorescent tubes with 22W LED alternatives.	89	£16	£40	2.5	<0.1
Toilets – replace 28W CFLs with 7.5W LED alternatives.	43	£9	£40	5.5	<0.1
Entrances – replace 28W CFLs with 7.5W LED alternatives.	21	£4	£20	5.5	<0.1
Vestries – replace 28W CFLs with 7.5W LED alternatives.	22	£4	£30	7.5	<0.1
Safe Room - replace 28W CFLs with 7.5W LED alternatives.	11	£2	£10	5.5	<0.1
Flower Room - replace 65W T8 fluorescent tubes with 22W LED alternatives.	22	£4	£10	2.5	<0.1
Basement - replace 65W T8 fluorescent tubes with 22W LED alternatives.	22	£4	£10	5.5	<0.1
Basement - replace 28W CFLs with 7.5W LED alternatives.	21	£4	£20	2.5	<0.1
Organ Loft - replace 100W halogen spotlights with 12.5W LED alternatives.	182	£32	£20	6.5	0.1
Organ Loft - replace 28W CFLs with 7.5W LED alternatives.	11	£2	£10	5.5	<0.1
External - replace 100W halogen floodlights with 60W LED alternatives.	62	£11	£75	7.0	<0.1
External - replace 28W CFLs with 7.5W LED alternatives.	32	£6	£30	5.5	<0.1
<b>TOTALS</b>	<b>5,444</b>	<b>£588</b>	<b>£1,565</b>	<b>3.0</b>	<b>1.4</b>

The headline messages from the audit are:

- ▲ £1,565 investment in energy reduction measures would achieve an estimated annual saving of 5,444kWh (combined electric and gas).
- ▲ Based on current electricity and gas tariffs, this would result in an annual financial saving of £1,565
- ▲ The simple payback period on this investment is 3.0 years.

The Church should check any faculty requirements with the DAC Secretary at the Diocese before commencing any works.

---

## 2 Church Information

A site survey was undertaken by Ros Harwood on Friday 21<sup>st</sup> February 2020. The survey was non-invasive (visual only) and entailed a general walk throughout the church areas, including back of house spaces and plant rooms.

**Photograph 1: St Luke's Church External View**



General Information	
Site Address	St Luke's Church, Brownley Street, Wythenshawe, M22 4PT
Listed Status	Grade II Listed
Building Age	1939
Floor Area	595
Usage	Typically 10 hours per week

---

### 3 Energy Procurement Review

Energy bills for gas and electricity have not been supplied. Current market rates for energy have been used to estimate consumption.

#### 3.1 Electricity

Day Rate	17.45 p/kWh
----------	-------------

#### 3.2 Gas

Rate	5.03 p/kWh
------	------------

The review has highlighted that there may be opportunities to gain environmental benefits from improved procurement of the energy supplies at this site.

We would therefore recommend that the Church obtains a quotation for its gas and electricity supplies from the CofE Parish Buying scheme (<https://www.parishbuying.org.uk/categories/energy/energy-basket>). This scheme only offers renewably sourced energy and therefore it is an important part of the process of making Churches more sustainable.

### 4 Energy Usage Details

#### 4.1 Cost & Consumption

Energy Type	Annual kWh
Gas	49,318
Electricity	13,026

If not already in place, it is recommended that the Church consider asking their suppliers to install smart meters so that the usage can be monitored more closely, and the patterns of usage reviewed against the times the building is in use.

#### 4.2 Energy Benchmarking (Based on CofE Shrinking the Footprint – Energy)

Energy Type	Size (Sqm)	Benchmark Energy Use (kWh/Sqm)	Actual Energy Use (kWh/Sqm)	Variance from Benchmark (%)
Gas	595	105	83	-20%
Electricity	595	20	22	10%

The Church is using less Gas than expected. The Church is using more Electric than expected.

---

## 5 Building Performance and Opportunities

The building is well run with proactive onsite team in terms of energy conversation with some areas of improvement already being identified. The following sections will highlight where further improvements could potentially be made.

### 5.1 Building Envelope

From visual inspection, the building envelope appears to be in a reasonable state of repair. Wall and roof insulation are not present.

### 5.2 Heating System – Boilers

Heating is provided to the church via 3no. boilers, each serving a different area of the church. The main church space is served by an IDEAL Concord boiler located in the basement, the back of the church is heated via a Glowworm boiler and an Ideal Logic+ System 24 boiler located in the Footprints room heats the Footprints room, the chapel and the community room. The boilers are programmed on a timer to the building use schedule however manual override is possible using the 1-hour boost function, to allow the building to be heated to the desired temperature for when the demise is scheduled to be occupied. Control panels are located on each of the boilers. The temperature and the schedule are kept the same, however manual override is possible if required so that the system can be switched on outside of the programmed hours, as well as the changing of the temperature set point.

While the boilers appear to be in good order, the client may wish to explore the possibility of installing an air to water heat pump heating system in order to move towards the goal of decarbonising energy consumption.

#### Photograph 2-4: Church Boilers



### 5.3 Heating System – Pipework and Distribution

The heating systems' pipework is generally good, however there was no insulation lagging on the pipework for either boiler. It is recommended that insulating lagging is fitted to the boilers' pipework to reduce heat loss. The pipework is evident in Photograph 2-4.


---

## 5.4 Heating System – Heat Emitters

Heating to the church is predominantly served via wall-mounted radiators supplied by heating pipes fixed to the walls and exposed at ground level. There are 9no. radiators in the church space, 2no. radiators in the vestries, 1no. radiator and 1no. gas wall heater in the chapel, 1no. radiator in the flower room, 1no. radiator in the corridor near the vestry, 3no. radiators in the community rooms and 3no. radiator in the toilets. Some of the radiators were blocked in the community rooms and the flower room. It is recommended that the space around radiators is cleared to improve the efficiency of space heating.

A portable plug-in heater is present in the chapel to provide additional heating when required. This can be an ineffective, inefficient and poorly controlled means of providing space heating, and can easily be left on when unoccupied. It is recommended that a more permanent heating solution be provided to these spaces if and when heating upgrades are undertaken.

**Photographs 6-8: Church Heat Emitter**

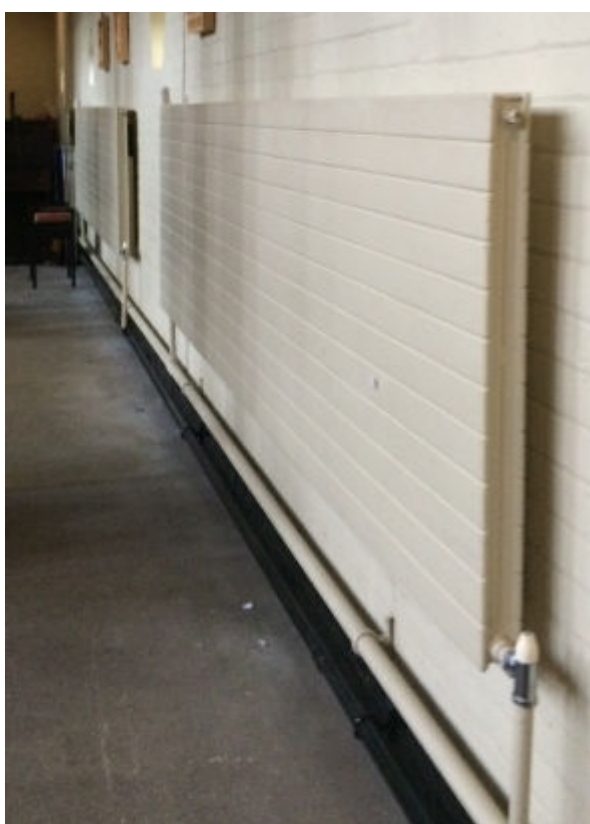

---

## 5.5 Hot Water System

Hot water is provided to the building via an Aquapoint III hot water heater, located in the kitchen, which is switched on as required. There is also an Ambiano 1650W point of use water heater in the church kitchen. Hot water consumption is considered to be nominal.

**Photograph 6 & 7: Electric Point-of-Use Water Heater and Aquapoint Water Heater**



## 5.6 Lighting

There is no lighting control system, motion detectors or daylight dimming controls. All light fittings are controlled via manual on/off switches.


The range of light fittings throughout the church and community centre areas are detailed below:

### Main Church

- ▲ 16no. 100W halogen spotlights – recommended to be replaced with 12.5W LED alternatives.
- ▲ 14no. 28W uplights – recommended to be replaced with 7.5W LED alternatives.
- ▲ 6no. 100W halogen floodlights – recommended to be replaced with 60W LED alternatives.
- ▲ 9no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.



Photographs 7, 8 & 9: Church Light Fittings

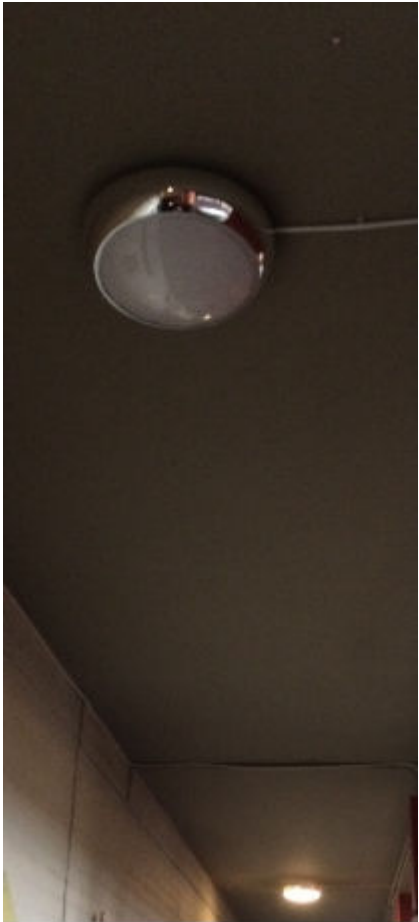

---

## Chapel

- ▲ 5no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

### Photographs 10: Compact Fluorescent Lamps (CFLs)



## Kitchens

- ▲ 2no. 65W fluorescent T8 tubes – recommended to be replaced with a 22W LED alternatives.
- ▲ 2no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

## Community Rooms

- ▲ 5no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.
- ▲ 6no. 65W fluorescent T8 tubes – recommended to be replaced with a 22W LED alternatives.
- ▲ 24no. 65W fluorescent (twin) T8 tubes – recommended to be replaced with 22W LED alternatives.

### Photograph 11: Twin Fluorescent T8 Tubes

---

## Corridors

- ▲ 5no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.



## Toilets

- ▲ 4no. 65W fluorescent T8 tubes – recommended to be replaced with 22W LED alternatives.
- ▲ 4no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

## Entrances

- ▲ 2no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

## Vestries

- ▲ 3no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

## Safe Room

- ▲ 1no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

## Flower Room

- ▲ 1no. 65W fluorescent T8 tubes – recommended to be replaced with 22W LED alternatives.


---

## Basement

- ▲ 1no. 65W fluorescent T8 tubes – recommended to be replaced with 22W LED alternatives.
- ▲ 2no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

## Organ Loft

- ▲ 4no. 100W halogen spotlights – recommended to be replaced with 12.5W LED alternatives.
- ▲ 1no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

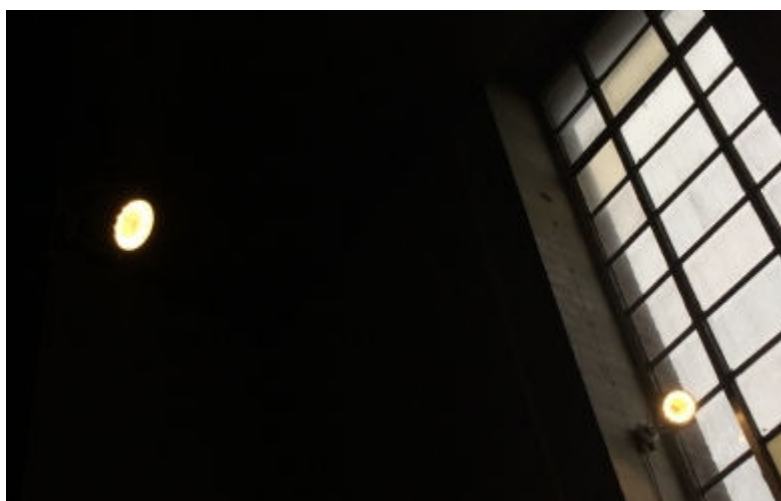

**Photograph 13: Halogen Spotlights**

## Outdoor

- ▲ 3no. 100W halogen floodlights – recommended to be replaced with 60W LED alternatives.
- ▲ 3no. 28W compact fluorescent lamps – recommended to be replaced with 7.5W LED alternatives.

## 5.7 Renewables

There are currently no renewables on-site. A free desktop survey can be carried out by a specialist solar installer to identify the possibility of installing solar PV panels.

## 6 Potential Saving Opportunities

As part of the assessment, we carry out a close inspection of M&E plant and their associated controls, with the aim of identifying any issues that have significant impact on energy consumption and correct building operation. We have reviewed the building and associated HVAC and lighting operations and identified the following potential energy conservation opportunities (ECOs), which should be investigated:

Category	Actions	Potential Annual Savings			Investment (£)	Simple payback (yrs.)
		Elec/Gas (kWh)	Cost (£)	(tCO <sub>2</sub> )		
Heating	Install insulating lagging on boiler pipework (estimated 3% saving)	2,910	£146	0.6	£200	1.5
Lighting	Main Church – replace 28W uplights with 7.5W LED alternatives.	149	£26	<0.1	£140	5.5
Lighting	Main Church – replace 100W halogen spotlights with 12.5W LED alternatives.	728	£127	0.2	£80	6.5
Lighting	Main Church – replace 100W halogen floodlights with 60W LED alternatives.	125	£22	<0.1	£150	7.0
Lighting	Main Church – replace 28W CFLs with 7.5W LED alternatives.	96	£17	<0.1	£90	5.5
Lighting	Chapel – replace 28W CFLs with 7.5W LED alternatives.	53	£9	<0.1	£50	5.5
Lighting	Kitchens - replace 65W T8 fluorescent tubes with 22W LED alternatives.	45	£8	<0.1	£20	2.5
Lighting	Kitchens - replace 28W CFLs with 7.5W LED alternatives.	21	£4	<0.1	£20	5.0
Lighting	Community Rooms – replace 28W CFLs with 7.5W LED alternatives.	53	£9	<0.1	£50	5.0
Lighting	Community Rooms – replace 65W T8 fluorescent tubes with 22W LED alternatives.	134	£23	<0.1	£60	2.5
Lighting	Community Rooms - replace 65W twin T8 fluorescent tubes with 22W LED alternatives.	537	£94	0.2	£240	2.5
Lighting	Corridors – replace 28W CFLs with 7.5W LED alternatives.	53	£7	<0.1	£50	5.5
Lighting	Toilets – replace 65W T8 fluorescent tubes with 22W LED alternatives.	89	£16	<0.1	£40	2.5

Lighting	Toilets – replace 28W CFLs with 7.5W LED alternatives.	43	£9	<0.1	£40	5.5
Lighting	Entrances – replace 28W CFLs with 7.5W LED alternatives.	21	£4	<0.1	£20	5.5
Lighting	Vestries – replace 28W CFLs with 7.5W LED alternatives.	22	£4	<0.1	£30	7.5
Lighting	Safe Room - replace 28W CFLs with 7.5W LED alternatives.	11	£2	<0.1	£10	5.5
Lighting	Flower Room - replace 65W T8 fluorescent tubes with 22W LED alternatives.	22	£4	<0.1	£10	2.5
Lighting	Basement - replace 65W T8 fluorescent tubes with 22W LED alternatives.	22	£4	<0.1	£10	5.5
Lighting	Basement - replace 28W CFLs with 7.5W LED alternatives.	21	£4	<0.1	£20	2.5
Lighting	Organ Loft - replace 100W halogen spotlights with 12.5W LED alternatives.	182	£32	0.1	£20	6.5
Lighting	Organ Loft - replace 28W CFLs with 7.5W LED alternatives.	11	£2	<0.1	£10	5.5
Lighting	External - replace 100W halogen floodlights with 60W LED alternatives.	62	£11	<0.1	£75	7.0
Lighting	External - replace 28W CFLs with 7.5W LED alternatives.	32	£6	<0.1	£30	5.5
<b>TOTAL ELECTRICITY SAVINGS</b>		<b>2,534</b>	<b>£442</b>	<b>0.8</b>	<b>£1,265</b>	<b>3.0</b>
<b>TOTAL GAS SAVINGS</b>		<b>2,910</b>	<b>£146</b>	<b>0.6</b>	<b>£200</b>	<b>1.5</b>
<b>GRAND TOTAL</b>		<b>5,444</b>	<b>£588</b>	<b>1.4</b>	<b>£1,565</b>	<b>3.0</b>

## 7 Assumptions

### 7.1 Assumptions

- ▲ Costs excludes labour, installation and access which will require the confirmation of a specialist contractor.
- ▲ Average cost of electricity at 17.45p/kWh.
- ▲ Average cost of gas at 5.03p/kWh.
- ▲ Electricity carbon emission rate of 0.31598 kgCO<sub>2</sub>/kWh.
- ▲ Natural Gas carbon emission rate of 0.20776 kgCO<sub>2</sub>/kWh.

---

## 7.2 Economic Life

CIBSE Guide M Appendix 12.A1 gives the economic life of plant common plant items. After this time the maintenance and repair make it economic to replace the asset. There will be energy savings inherent in the new equipment and the need to meet the minimum requirements of the Building Regulations. Some capital plant has long payback periods, when based on energy efficiency alone, but these should be part of an asset replacement programme with only the 'additional' cost of higher than minimum required energy standards being used to calculate ROI.

## 7.3 Implementation

Reviews of Energy Projects and Initiatives are designed to provide a high-level indication of options available clients and will not constitute a recommendation for implementation. Pricing and potential savings are indicative values and will not constitute an offer.

## 7.4 Cumulative Savings and Double Counting

It should be noted that further investigation may rule out some measures as impractical, either physically or financially. Some measures are mutually exclusive and provide diminishing returns if implemented together. For example, if the lighting load is reduced through more efficient lighting, there will be an increase in the heat demand on boilers, as the new lights generate less heat.

Each energy conservation measure is assessed independently at this stage so that they can be fairly compared. An assessment of any overlap will be undertaken once any projects are selected for implementation.

## 8 Funding Sources

There are a variety of charitable grants for Churches undertaking works and a comprehensive list of available grants is available at:

<https://www.parishresources.org.uk/wp-content/uploads/Charitable-Grants-for-Churches-Nov-2019.pdf>

## 9 Faculty Requirements

It must be noted that all works intended to be undertaken should be discussed with the DAC at the Diocese.

Minor works can be undertaken without the need for consultation and would include changing of light bulbs within existing fittings, repair and maintenance works to heating and electrical systems and repairs to the building which do not affect the historic fabric.

Major works which can be undertaken without a faculty but must be consulted on with permission sought from the Archdeacon through the DAC. This includes works of adaptation (but not substantial addition or replacement) of heating and electrical systems and also the replacement of existing boilers so long as the same pipe work, fuel source and flues are used. It can also be used to replace heating controls.

All other works will be subject to a full faculty.

Works which affect the external appearance of the church will also require planning permission (but not listed building consent) from the local authority and this will be required for items such as PV installations,

---

## 10 Limitations

The recommendations contained in this Report represent ESOS Energy's professional opinions, based upon the information listed in the Report, exercising the duty of care required of an experienced Sustainability Consultant.

ESOS Energy obtained, reviewed and evaluated information in preparing this Report from the Client and others. ESOS Energy conclusions, opinions and recommendations has been determined using this information. ESOS Energy does not warrant the accuracy of the information provided to it and will not be responsible for any opinions which ESOS Energy has expressed, or conclusions which it has reached in reliance upon information which is subsequently proven to be inaccurate.

This Report was prepared by ESOS Energy for the sole and exclusive use of the Client and for the specific purpose for which ESOS Energy was instructed. Nothing contained in this Report shall be construed to give any rights or benefits to anyone other than the Client and ESOS Energy, and all duties and responsibilities undertaken are for the sole and exclusive benefit of the Client and not for the benefit of any other party. In particular, ESOS Energy does not intend, without its written consent, for this Report to be disseminated to anyone other than the Client or to be used or relied upon by anyone other than the Client. Use of the Report by any other person is unauthorised and such use is at the sole risk of the user. Anyone using or relying upon this Report, other than the Client, agrees by virtue of its use to indemnify and hold harmless ESOS Energy from and against all claims, losses and damages (of whatsoever nature and howsoever or whensoever arising), arising out of or resulting from the performance of the work by the Consultant.